

Please read this document carefully before using this product. The guarantee will be invalidated if the device is damaged by not following instructions detailed in the manual. The company shall not be responsible for any damage or losses however caused, which may be experienced as a result of the installation or use of this product.

# **ENDA EDT2411A DIGITAL THERMOSTAT**


#### Thank you for choosing **ENDA EDT2411A** temperature controller.

- > 35x77mm.
- On-Off control.
- Relay output for cooling or heating control.
- Single NTC probe input.
- Offset value can be entered for NTC input.
- Compressor protection parameters can be set.
- In case of probe failure, output status can be set to ON, OFF or periodic.
- Upper and Lower setpoint value limits can be adjusted.
- Selectable "Smart Defrost" feature.
- Defrosting duration and intervals can be adjusted.
- 6 Different warning tone selections.
- Lower and upper alarm limit can be adjusted to depending on set value.
- Temperature unit can be selected °C or °F.
- Digital input :
  - External alarm
  - Initiate defrost
- Transfer device parameter settings with ENDAKEY
  - No power-up required.
- RS485 ModBus protocol communication feature (optional).
- CE marked according to European Norms.



# R<sub>™</sub>HS Compliant







### **CONNECTION DIAGRAM**




**ENDA EDT2411A** is intended for installation in control panels. Make sure that the device is used only for intended purpose. The electrical connections must be carried out by a qualified staff and must be according to the relevant locally applicable regulations. During an installation, all of the cables that are connected to the device must be free of electrical power. The device must be protected against inadmissible humidity, vibrations, severe soiling and make sure that the operation temperature is not exceeded. The cables should not be close to the power cables or components.



Equipment is protected throughout by DOUBLE INSULATION.




Holding screw 0.4-0.5Nm



#### Note:

- 1) Mains supply cords shall meet the requirements of IEC 60227 or IEC 60245.
- 230V AC /LV Supply

  2) In accordance with the safety regulations, the power supply switch shall bring the identification of the relevant instrument and it should be easily accessible by the operator.

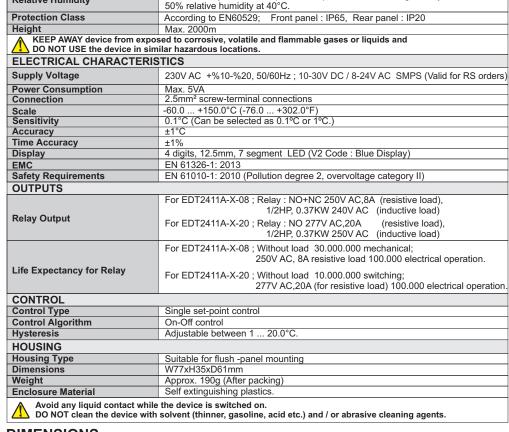

Max. humidity 80% for temperatures up to 31°C decreasing linearly to

**DIMENSIONS** 



**□ → )** 

**ENVIRONMENTAL CONDITIONS** 

**Relative Humidity** 


Ambient / Storage Temperature 0 ... +50°C/-40 ... 85°C (without icing)

#### To removing mounting clamps:

- Push the flush-mounting clamp in direction 1 as shown in the figure below. Then, pull out the clamp in direction 2.

Panel cut-out

71,5mm



Depth

#### Note:

1) Panel thickness should be maximum 7mm. 2) If there is no 60mm free space at the back side of the device, it would be difficult to remove it from the panel.




SİSEL MÜHENDİSLİK ELEKTRONİK SAN. VE TİC. A.Ş. Şerifali Mah. Barbaros Cad. No:18 Y.Dudullu 34775 ÜMRANIYE/İSTANBUL-TURKEY Tel: +90.216.499.46.64 Pbx. Fax: +90.216.365.74.01

Flush mounting

clamp

8,




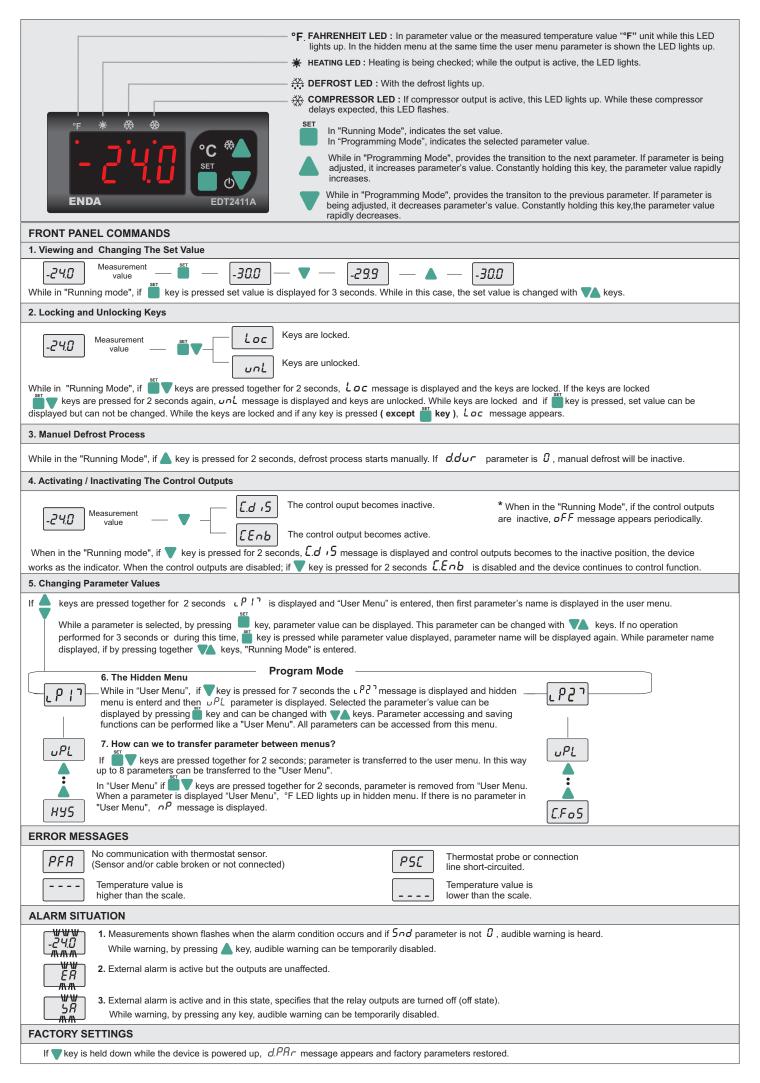

2/4

EDT2411A-EN-04-220103

#### **ENDAKEY PARAMETER TRANSFER**



### TRANSFERRING THE PARAMETERS FROM ENDAKEY TO DEVICE


While in "Running Mode", if \(\bigve{V}\) key on device or "Read" button on "ENDAKEY" is pressed, "\(dL'\)' message appears on display and parameters are read and transferred to the device. If the parameter transfer is successful, the "  $r \in F$ " message appears and the device begins to work with the loaded parameter values. If the parameters are wrong, incorrect or " ENDAKEY " is faulty, " <code>Err</code> " message appears. Parameters will not be changed on device.

#### TRANSFERRING THE PARAMETERS FROM DEVICE TO ENDAKEY

While in "Running Mode", if A key is pressed on device, "uL" message appears on display and parameters are read and transferred to the device. If process success, " 5 uc " message appears. In case of failure, " Err" message appears. Parameters will not be changed on device.

NOTE 1: No power-up required for transfering the parameter by using "ENDAKEY". For long battery life, "ENDAKEY" must be disconnected from device after the transferring process. NOTE 2: Please specify at order "ENDAKEY" if required.

CONTRO	L PARAMETERS	Min.	Max.	UNIT	DEFAULT VALUE
υPL	Upper limit for setpoint	-60.0	υPL	°C	150
LoL	Lower limit for setpoint	LoL	150.0	°C	-60
HY5	Differential cooling (hysteresis)	D. 1	20.0	°C	2
oFF	Offset value for cooling	-20.0	20.0	°C	0
CONFIGU	RATION PARAMETERS				
E.E 4P	Control type selection ( $HE = (*)$ heating control is selected, $\mathcal{L}_{\mathcal{O}} = \text{Cooling control}$ is selected.) Defrost control is disabled if the $\mathcal{L}_{\mathcal{E}}\mathcal{P}$ parameter is set to $\mathcal{H}_{\mathcal{E}}$ .	٤٥	HE		٤٥
Un iE	Temperature unit	٥٢	oF		٥٤
dPnŁ	Decimal point (no= decimal point isn't shown 22°C, 4£5=decimal point is shown 22.3°C.)	no	YE 5		no
Snd	Buzzer type selection. Six different sounds can be selected. The alarm sound will be disabled when set to 0.	0	Б		0
d. inP	Digital input types. $nd$ : Digital input not used. $\mathcal{E}\mathcal{R}$ : External alarm, $\mathcal{E}\mathcal{R}$ message flashes on the display. Output is not affected. $\mathcal{S}\mathcal{R}$ : Important external alarm. $\mathcal{S}\mathcal{R}$ message flashes on the display, relay output is switched off. $\mathcal{H}\mathcal{E}$ : Control type selection; $\mathcal{E}\mathcal{E}\mathcal{P}$ parameter will be switched to the $\mathcal{H}\mathcal{E}$ or $\mathcal{E}\mathcal{O}$ when this parameter is changed. $\mathcal{F}\mathcal{E}$ : Defrost operation starts.	nd	dF		nd
dd ,	Digital input delay. The period of the digital inputs to be active.	0:00	99:00		0:00
	Digital input polarity. c L = While a digital input contact is closed, it is activated.	ΕL	oP		CL
dPo	$\sigma P$ = While a digital input is opened, it is activated.		or .		LL
COMPRE	SSOR PROTECTION PARAMETERS				
[.Pon	Delay time for the compressor after power is on.	0:00	99:00	min:sec	1:00
C.FoS	Delay time required for the compressor to restart following a stop.	0:00	99:00	min:sec	1:00
E.PPn	On time for the compressor output in the case of probe failure.	0.00		min:sec	0:00
E PPF	Off time for the compressor output in the case of probe failure	0:00		min:sec	1:00
	CONTROL PARAMETERS	0.00	33.00	111111.300	7.00
d.SñE	Smart Defrost selection (no: Defrost counter (between 2 defrost duration) decrease irrespective of d. int status of the compressor. 9E5: Defrost counter decreases as long as compressor work).	no	<i>YE</i> 5		no
d.dur	Defrost duration (If $d.dur = 0$ selected, automatic and manual defrost is disabled).	0:00	99:00	min:sec	1:00
d. int	Time between 2 consecutive defrosts.	0:00	99:00	hr:min	1:00
d.d5P	Display configuration in defrosting process ( $r  \mathcal{E}$ : Real temperature is displayed during defrost. ( $L  c$ : During a defrosting process, last measured temperature value is displayed before the defrosting process. This value remains constant until the end of defrosting.	Lc.	ΓΕ		Lc.
d.drE	Delay time for display real temperature after defrost is over.	0:00	99:00	min:sec	1:00
d.Pon	Defrost process with power. ( $no = Defrost process$ is not started when power-up. 9E5 = Defrost process starts when power-up).	no	<i>YE</i> 5		no
d.dPo	Delay time for defrosting after power-up.	0:00	99:00	min:sec	1:00
ALARM C	ONTROL PARAMETERS				
RuPL	Limit for upper alarm level. When $REYP$ is changed, $RuPL$ should be readjusted.	RLoL	150.0	°C	150
R.L.o.L	Limit for lower alarm level. When REYP is changed, RLoL should be readjusted.	-60.0	RuPL	°C	-60
RHYS	Hysteresis alarm	0.1	20.0	°C	5
R.E. Y.P	Alarm configuration. ( $RbS$ = Independent alarm. Alarm values are $RLoL$ and $RuPL$ .) ( $rEF$ = Relative alarm. Alarm values are $SEF - RLoL$ and $SEF + RuPL$ .) NOTE: Upper and Lower alarm level variables are determined according to the " $RESP$ " parameter. If $RESP = RbS$ , $RLoL$ and $RuPL$ . If $RESP = rEF$ , $LoL = SEF - RLoL$ and $RuPL$ .	ЯЬЅ	rEF	-	ЯЬ5
RdFL	Time delay to display alarm message after alarm is on.	0:00	99:00	min:sec	0:00
R.dPo	Time delay to display alarm message after power is on.	0:00	99:00	hr:min	0:10
	COMMUNICATION PARAMETERS	. 0.00	22.00		J. 70
Rdr 5	Modbus slave device address for device	1	247		1
bRud	Modbus communication speed ( Baud rate, 0 : oFF, 1 : /200, 2 : 2400, 3 : 4800, 4 : 9500, 5 : /9200 )	oFF	19.20	bps	9600
	,		, ,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,	1	2000

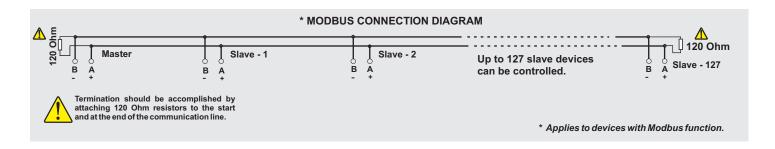





#### ENDA EDT2411A DIGITAL THERMOSTAT MODBUS PROTOCOL ADDRESS MAP 1.1 HOLDING REGISTERS **Holding Register** Data Parameter Read/Write **Status** <u>Addresses</u> Type Value **Data Content** Permission **Decimal** Hex 0000d 0x0000 word Set value Read / Write -20 0001d 0x0001 Set point upper limit υPL word Read / Write 150 0002d 0x0002 word Upper level alarm R.uPL Read / Write 150 0003d 0x0003 word Set point lower limit Read / Write LoL -60 0004d 0x0004 Lower level alarm word Read / Write A.L.o.L -60 0005d 0x0005 word The offset value for the cooling oFF Read / Write 0 0006d 0x0006 word Cooling hysteresis HY5 Read / Write 2 0007d 0x0007 word Switch hysteresis for alarm A.HYS Read / Write 2 0008d 8000x0 word Type of buzzer sound Snd Read / Write 0 0009d Digital input types .0=nd;1=ER;2=5R;3=HE;4=dFd. inP 0x0009 word Read / Write nd 0010d 0:00(0 sec)0x000A Digital input delay word 99 , Read / Write Delay time for the compressor after power is on. 0x000B word C.Pon Read / Write 1:00(60 sec) 0011d C.FoS Delay time required for the compressor to restart following a stop. Read / Write 0012d 0x000C word 0:00(0 sec)0013d 0x000D On time for the compressor output in the case of probe failure E.PPn0:00(0 sec)word Read / Write 0014d 0x000E Off time for the compressor output in the case of probe failure r ppr word Read / Write 1:00(60 sec) 0015d 0x000F word Defrost duration d.dur Read / Write 1:00(60 sec) 0016d The time between 2 consecutive defrosts. 1:00(60 min) 0x0010 word d. int Read / Write 0017d 0x0011 word Delay time for defrosting after power is on. d.dPo 1:00(60 sec) Read / Write 0018d 0x0012 word After the cooling process of cooling start-up delay Read / Write 1:00(60 sec) d.drE 0019d 0x0013 Read / Write 0:00(0 sec)word Time delay to display alarm message after alarm is on. R. dFL

## 1.2 INPUT REGISTERS

word

0x0014

0020d

Input Register Addresses		Data Type	Data Content	Parameter Name	Read/Write Permission
Decimal	Hex				
0000d	0x0000	word	Measured temperature value (°C / °F)		Read

Time delay to display alarm message after power is on.

R.dPo

Paramete

Read / Write

Read/Write

0:10(10 min)

**Data Content** 

## 1.3 DISCRETE INPUTS

Data

**Discrete Input** 

Addresses

Addresses		Type	Data Content	Name	Permission	
Decimal	Hex	.,,,,			i cillission	
0000d	0x0000	Bit	Control output status (0=OFF; 1=ON)		Read	
1.4 COILS						
Coil Addresses		Data Type	Data Content	Parameter Name	Read/Write Permission	
Decimal	Hex				remission	
00d	0x00	Bit	Control type selection. OFF = $\mathcal{L}a$ . ON = $\mathcal{H}\mathcal{E}$	C.E YP	Read / Write	
01d	0x01	Bit	Temperature unit. OFF = $^{\circ}\mathcal{L}$ , ON = $^{\circ}\mathcal{F}$	Un it	Read / Write	
02d	0x02	Bit	Decimal point . OFF=na . ON=9E5	d.PnE	Read / Write	
03d	0x03	Bit	Digital input polarity. OFF = $cL$ . ON = $aP$	dPo	Read / Write	
04d	0x04	Bit	Smart Defrost selection. OFF = na, ON= 9E5	d.SñE	Read / Write	
05d	0x05	Bit	Display configuration during defrost. OFF = $L_C$ , ON = $CE$	d.d5P	Read / Write	
06d	0x06	Bit	Defrost process is started by power-up. OFF = $\alpha a$ , ON = $9E$	d.Pon	Read / Write	
07d	0x07	Bit	Alarm configuration. OFF = $865$ , ON = Relative alarm $\sim EF$	R.E. Y.P	Read / Write	



<sup>\*</sup> Holding and Input Register parameters of type integer, those "signed integer" is defined as the decimal port of and associated with these parameters. (So,"14.0" is a parameter value of "140" will be read in). Relevant parameters for a period of "mm:ss" type ones in seconds, "hh:mm" while those species defined in minutes.